


## Detectable Warning Device (DWD) Decision Making Flowchart *Driveways and Private Roads*

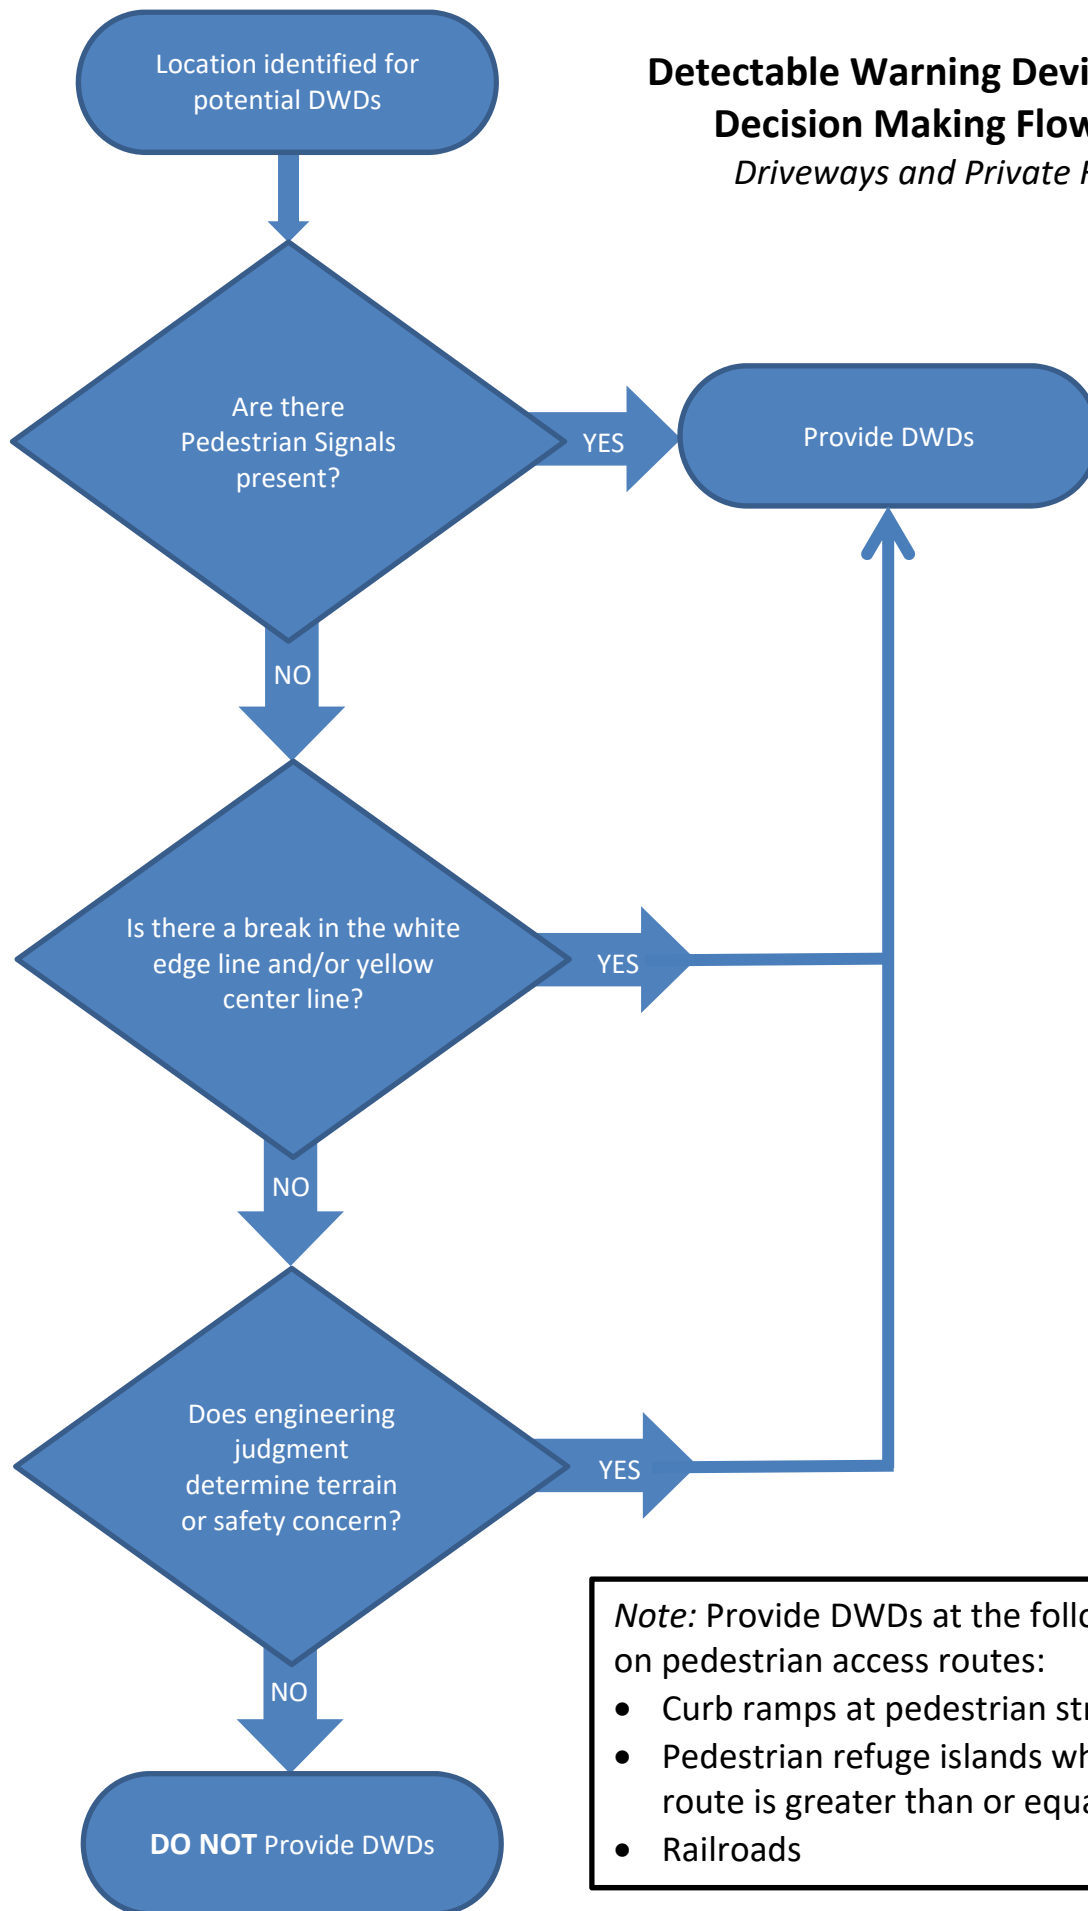

*Note:* Provide DWDs at the following locations on pedestrian access routes:

- Curb ramps at pedestrian street crossings
- Pedestrian refuge islands where the access route is greater than or equal to 6 feet
- Railroads